

## Features

4100ES Cabinets are available with one, two, or three bays.

**Figure 1: 4100ES two-bay cabinet with ES Touch Screen Display**



### Master controller bay, top

- Models available with Color ES Touch Screen Display as shown in [Figure 1](#), Monochrome 2 line x 40 Character Display
- 32-Bit Master Controller with color-coded operator interface including raised switches for high-confidence feedback
- Dual configuration program CPU, convenient service port access, and capacity for up to 3000 addressable points
- CPU assembly includes 2 GB dedicated compact flash memory for on-site system programming and information storage
- ES Power Supply (ES-PS) and charger with onboard alarm relay, programmable auxiliary power output and provisions for one 4 in. x 10 in. or two 4 in. x 5 in. compatible option cards such as IDNet2 addressable device interface, Conventional NAC or Addressable IDNAC SLC modules. For additional details refer to *ES-PS and ES-XPS Installation Instructions 579-1288*.
- Existing control panels have upgrade kits available.

### Network compatibility

Compatible with Simplex ES Net or 4120 Fire Alarm Networks.

### Standard addressable interfaces

- 250 point addressable IDNet 2 SLC channel with electrically isolated dual short circuit isolating loops that supports TrueAlarm analog sensors and IDNet communications monitoring and control devices
- Remote annunciator module support through RUI+ (remote unit interface) communications port.

## Optional modules

- Building Network Interface Module (BNIC) for Ethernet connectivity options, refer to data sheet *S4100-0061*
- Electrically isolated output two-loop IDNet 2 and four-loop IDNet 2+2 modules with short circuit isolation output loops allowing use with either shielded or unshielded, twisted or untwisted single pair wiring
- Fire Alarm Network Interfaces, DACTs, city connections, and up to five RS-232 ports for printers and terminals
- Compatible with Connected Services Gateway to support central station communication and enable SafeLINC Cloud Services, refer to datasheet *S2080-0091*
- MAPNET II addressable device modules and MAPNET II quad isolator modules
- IDNAC signalling line circuits (SLCs) for addressable appliance control
- Alarm relays, auxiliary relays, additional power supplies, IDC modules, NAC expansion modules
- Service modems, VESDA Air Aspiration Systems interface, ASHRAE BACnet Interface, TCP/IP Bridges
- LED/switch modules and panel mount printers
- Emergency communications systems (ECS) equipment, 8 channel digital audio or 2 channel analog audio
- Optional Redundant CPU configuration with redundant CPU conversion kit. For additional details refer to *Redundant CPU Installation Instructions A16382C9WB*
- 8-point zone/relay module, each point is selectable as an IDC input or relay output. Class A IDCs require two points (one out and one return). Relays rated for 2 A at 30 VDC (resistive) and configurable as either normally open or normally closed.
- Compatible with Simplex remotely located 4009 IDNet NAC Extenders, up to ten for each IDNet SLC.

### Listings information\*

- UL 864, Fire Detection and Control (UOJZ), Smoke Control Service (UUKL), Releasing Device Service (SYZV), Emergency Communication and Relocation Equipment (UOQY)
- UL 1076, Proprietary Alarm Units - Burglar (APOU)
- UL 2017, Process Management Equipment (QVAX), Emergency Alarm System Control Units (FSZI)
- UL 1730, Smoke Detector Monitor (UULH)
- UL 2572, Mass Notification Systems (PGWM)
- CAN/ULC-S527 Control Units for Fire Alarm Systems (UOJZ7), Releasing Device Service (SYZV7)
- CAN/ULC-S559 Central Station Fire Alarm System Units (DAYR7)
- ULC/ORD-C1076 Proprietary Burglar Alarm Units and Systems (APOU7)
- ULC/ORD-C100 Smoke Control System Equipment (UUKL7)

## Software feature summary

### CPU provides dual configuration programs

- Two programs ensure optimal system protection and commissioning efficiency with one active program and one reserve.
- The system reduces downtime by remaining operational during download.

### PC based programmer features

- Convenient front panel accessed Ethernet port for quick and easy download of site-specific programming.
- You can upload or download modifications for greater service flexibility.

\* See module information sections for product that is UL or ULC listed and additional listing information. This product has been listed by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7165-0026:251(4100ES) for allowable values and/or conditions concerning material presented in this document. Accepted for use - City of New York Department of Buildings - MEA35-93E. At the time of publication only UL and ULC listings are applicable to ES Net network products. Additional listings may be applicable; contact your local Simplex product supplier for the latest. © 2025 Johnson Controls. All rights reserved.

- The software downloads firmware enchantments to the onboard flash memory.

#### Operator interface features

- TrueAlarm individual analog sensing with front panel information and selection access.
- Dirty** TrueAlarm sensor maintenance alerts, service and status reports including **almost dirty**.
- TrueAlarm magnet test indication appears as a distinct **test abnormal** message when in test mode.
- TrueAlarm sensor peak value performance report.
- Operators can use **Install Mode** to group multiple troubles for uninstalled modules and devices into a single trouble condition, typical with future phased expansion. With future equipment and devices grouped into a single trouble, operators can more clearly identify events from the commissioned and occupied areas.
- Module level ground fault searching assists installation and service by locating and isolating modules with grounded wiring.
- Recurring Trouble Filteringing** allows the panel to recognize, process, and log recurring intermittent troubles, such as external wiring ground faults, but only sends a single outbound system trouble to avoid nuisance communications.
- WALKTEST** silent or audible system test performs an automatic self-resetting test cycle.

#### Introduction

4100ES Series Fire Detection and Control Panels provide extensive installation, operator, and service features with point and module capacities suitable for a wide range of system applications. An onboard Ethernet port provides fast external system communications to expedite installation and service activity. Dedicated compact flash memory archiving provides secure on-site system information storage of electronic job configuration files.

#### Modular design

A wide variety of functional modules are available to meet specific system requirements. Operators can use selections to configure panels for either Stand-Alone or Networked fire control operation. InfoAlarm Command Center options provide convenient expanded display content, detailed on data sheet *S4100-1045*.

#### Module Bay description


The **Master Controller Bay** (top) includes a standard multi-featured ES power supply, the master controller board, expansion space for optional features, and operator interface equipment.

The **Expansion Bays** include a Power Distribution Interface (PDI) for new 4 in. x 5 in. flat design option modules and also accommodate 4100-style modules.

The **Battery Compartment** (bottom) accepts two batteries, up to 50 Ah, to be mounted in the cabinet without interfering with module space.

Figure 2 identifies bay locations using a three bay cabinet for reference.

Figure 2: 4100ES Module Bay reference

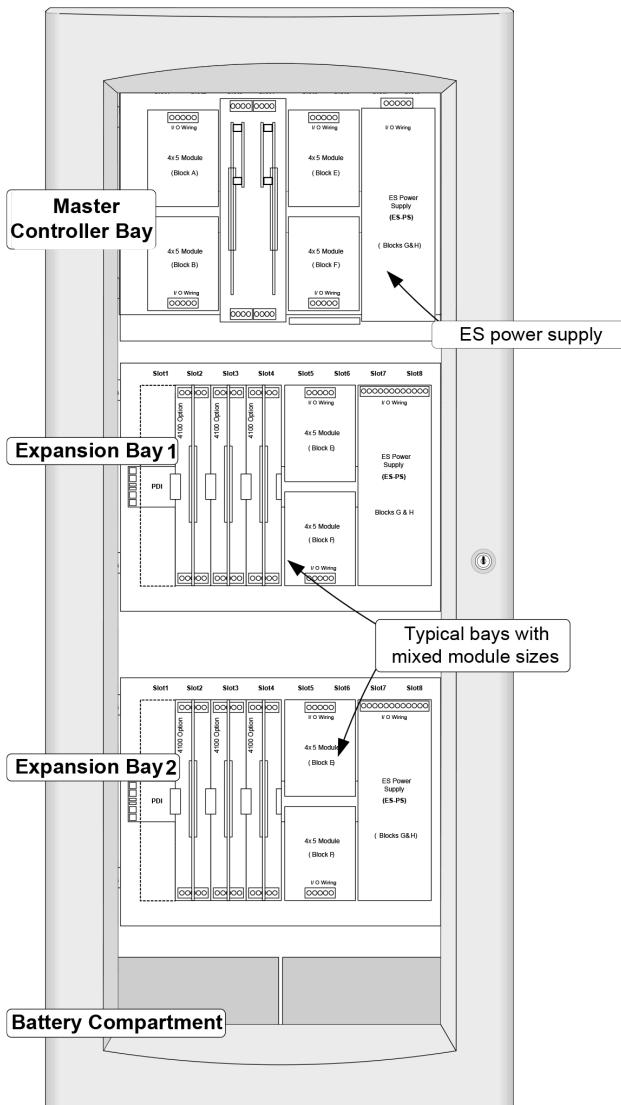

## Mechanical description

- Boxes can be close-nipped. Each box provides convenient stud markers for drywall thickness and nail-hole knockouts for quicker mounting.
- Smooth box surfaces are provided for locally cutting conduit entrance holes exactly where required.
- The latching dress panel (retainer) assembly easily lifts off for internal access.
- NACs can be mounted directly on power supply assemblies providing minimized wiring loss, compact size, and readily accessible terminations.
- Packaging supports traditional 4100-style motherboard with daughter cards.
- Modules are power-limited except as noted, such as relay modules.
- The NEMA 1/IP30 box is ordered separately and available for early installation.
- Doors are available with tempered glass inserts or solid. Boxes and doors are available in platinum or red.
- Boxes and door/retainer assemblies are ordered separately for each system requirements. Refer to data sheet S4100-0037 for details.

## Operator interface detail reference

4100ES Fire Alarm Control Units are provided with either an enhanced Color ES Touch Screen Display or a basic Monochrome 2 Line by 40 Character operator interface depending on the model selected. The following illustrations highlight the primary functions of each.

Figure 3: ES Touch Screen Display interface

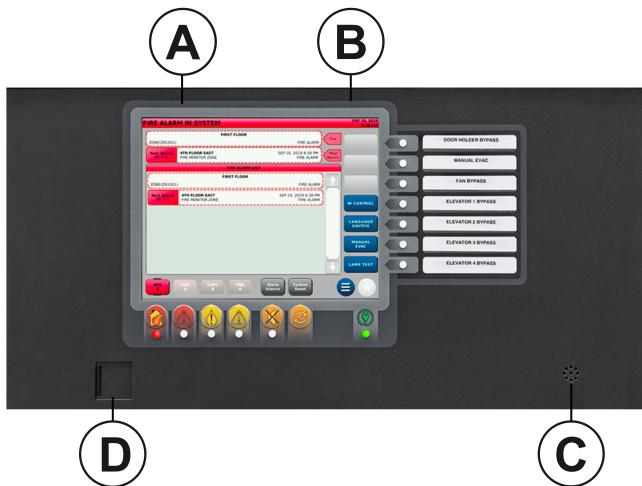


Table 1:

Callout	Description
A	Touchscreen.
B	You can directly view the operator interface panel, without an access door.
C	Panel sounder.
D	Upload/Download Ethernet port access, under a sliding cover.

Figure 4: 2 x 40 Operator interface

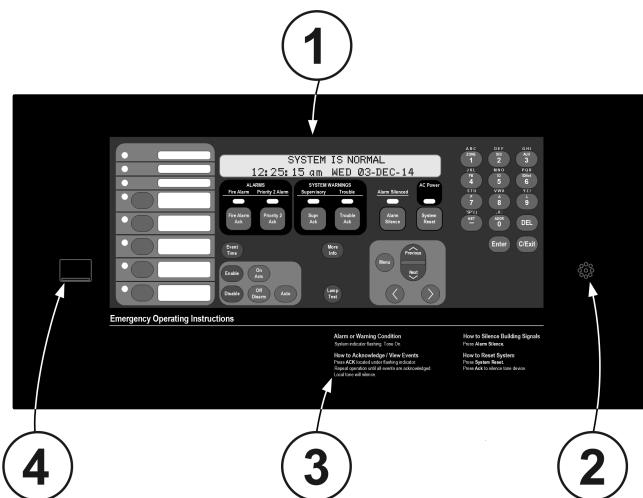


Table 2:

Callout	Description
1	You can directly view the operator interface panel, without an access door.
2	Panel sounder.
3	Basic operator instructions, printed on interface mounting plate.
4	Upload/Download Ethernet port access, under a sliding cover.

## Compatible peripheral devices

The 4100ES is compatible with an extensive list of remote peripheral devices including printers, CRT/keyboards (up to five total), and both conventional and addressable devices including TrueAlarm analog sensors and TrueAlert addressable appliances.

## Master Controller Bay module details

### Master Controller and Motherboard

- Master Controller mounts in Slot 2 of a two slot motherboard and provides one Class B or Class A, RUI+ communications channel configurable for isolated or un-isolated operation.
- Slot 1 of the motherboard is primarily for an optional network interface card, or secondarily for the 4100-6038 dual RS-232 board.
- RUI+ and RUI communications controls up to 31 remote devices for each master controller at up to 2500 ft (762 m) for single run, or 10,000 ft (3048 m) total if wiring is Class B and T-tapped. If more distance is required, up to four total RUI channels are supported. Add up to three 4100-1291 RUI Expansion Modules (4100-1291 provides unisolated RUI communications).
- Compatible RUI+ and RUI remote equipment includes: MINIPLEX transponders, 4603-9101 LCD Annunciators, 4602-9101 Status Command Units (SCU), 4602-9102 Remote Command Units (RCU), 4602 Series LED Annunciator Panels, 4100 Series 24 I/O and LED/Switch modules, (4602 series annunciators require un-isolated communications).
- Up to four RUI channels (combination of built-in RUI+ and optional RUI modules) are supported for each master controller.
- Open slot space on the left of the CPU motherboard is available for either another dual slot motherboard, or for one or two block modules, see [Figure 18](#).

### ES-PS Master Controller power supply

- Rating is up to 9.5 A total without a fan or up to 12.7 A total with a fan using Special Application appliances, or up to 5 A total with Regulated 24 DC appliance loads.

- Outputs are power-limited, except for battery charger and city circuits.
- Provides system power, battery charging, auxiliary power, auxiliary relay, earth detection, electrically isolated IDNet 2 communications channel for 250 points (4100-3117), three 3 A conventional NACs (4100-5450) or three 3 A IDNAC addressable SLCs (4100-5451), two block spaces for compatible optional modules and provisions for either an optional City Connect Module or an optional Alarm Relay Module (City Connect or Alarm Relay module requires one available block space).
- **IDNet 2 SLC Output** (4100-3109 and 4100-3117) provides an electrically isolated Class B or Class A communications channel with dual short circuit isolating loops for up to 250 addressable devices, as described in Addressable Device Control (requires one block space from ES-PS power supply or Master Controller bay).
- **Conventional NAC Module** (4100-5450) provides three outputs individually selectable as a Conventional NAC (Class B or Class A) or an Auxiliary Power output. When mounted on the ES-PS power supply, each NAC is rated at 3 A for Special Application appliances (9 A max for each card) or 2 A for Regulated 24 DC loads (4 A max for each card). NAC operation supports synchronized strobe or SmartSync horn/strobe operation over two wires. Auxiliary power outputs are rated for 3 A continuous duty. The total auxiliary power output for each power supply is limited to 5 A (requires one block space).
- **IDNAC Addressable Notification SLC Module** (4100-5451) provides three 3 A IDNAC addressable notification SLCs compatible with both TrueAlert ES and TrueAlert addressable notification appliances and remote 4009 IDNAC Repeaters used to extend power and wiring distances (requires two block spaces).
- **Dual Class A IDNAC Isolator (DCAI) Module** (4100-6103) creates two Class A outputs from one IDNAC SLC Class B input. Up to two can be connected to one IDNAC SLC, with up to 6 total for each ES-PS power supply. The total Class A output loop current is limited to the 3 A rating of the IDNAC SLC and requires one block space.
- **Battery Charger** is dual rate, temperature compensated, and charges up to 50 Ah sealed lead-acid batteries mounted in the battery compartment, or 33 Ah for single bay cabinets. Also is UL and ULC listed for charging up to 110 Ah batteries mounted in an external cabinet. Refer to data sheet S2081-0012 for details.
- **Battery and Charger Monitoring** includes battery charger status and low or depleted battery conditions. Status information provided to the master controller includes analog values for: battery voltage, charger voltage and current, actual system voltage and current, individual NAC currents, and individual IDNAC SLC currents.
- **Low Battery Cutout** is selectable for each ES-PS power supply.
- **2 A Programmable Output** is selectable for conventional SNAC or Auxiliary power operation.
  - SNAC operation supports conventional non-synchronous NAC operation to provide supervised reverse polarity for sounder base power, Suppression Release Peripheral (SRP) power, or other coded NAC operation requirements.
  - Auxiliary (AUX) power operation can be used for sounder base power, four-wire detector power, or door holder. Relay is selectable as N.O. or N.C and rated for 2 A at 32 VDC and 30 VAC (resistive). Supervised AUX operation does not require an end-of-line relay to provide Power-Limited operation.
- **Auxiliary Relay** is selectable as N.O. or N.C., rated 2 A at 32 VDC or 30 VAC (resistive), and is programmable as a trouble relay, either normally energized or normally de-energized, or as an auxiliary control.
- **Optional City Connect Module** (4100-6031, with disconnect switches, or 4100-6032, without disconnect switches) can be selected for conventional dual circuit city connections and requires one block space.
- **Optional Alarm Relay Module** (4100-6033) provides three Form C

relays that are used for Alarm, Trouble, and Supervisory, rated 2 A resistive at 32 VDC and requires one block space.

## IDNet SLC for Addressable Device Communications

### Overview

The 4100ES provides standard addressable device communications for IDNet compatible devices and accepts optional modules for communications with MAPNET II compatible devices. Using a two wire communications circuit, you can interface individual devices such as manual fire alarm stations, TrueAlarm sensors, conventional IDC zones, and sprinkler waterflow switches to the addressable controller to communicate their identity and status.

Use the addressability feature to display the location and condition of the connected device on the operator interface LCD and remote system annunciators. Additionally, control circuits such as fans or dampers may be individually controlled and monitored with addressable devices.

### Addressable operation

Each addressable device on the communication channel is continuously interrogated for status condition such as: normal, off-normal, alarm, supervisory, or trouble. Both Class B and Class A operations are available. Sophisticated poll and response communication techniques ensure supervision integrity and allow for **T-tapping** of the circuit for Class B operation. Devices with LEDs pulse the LED to indicate receipt of a communications poll and can be turned on steady from the panel.

### IDNet channel capacity

The CPU bay ES-PS provides an IDNet 2 signaling line circuit (SLC) that supports up to 250 addressable monitor and control points intermixed on the same pair of wires. IDNet 2 and IDNet 2+2 Module SLCs are isolated from other system reference voltages to reduce common mode noise interaction with adjacent system wiring. Additional 250 address IDNet 2 or IDNet 2+2 Modules are available, see [Table 23](#).

**Table 3: IDNet, MAPNET II, IDNet 2, and IDNet 2+2 SLC wiring common specifications**

Specification	Description	
Maximum Distance from Control Panel for each Device Load	1 to 125	4000 ft (1219 m), 50 ohms
	126 to 250	2500 ft (762 m), 35 ohms
Connections		Terminals for 18 to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> )

**Table 4: IDNet and MAPNET II Specifications**

Specification	Description	
Wire Type	New Installation	Shielded twisted pair (STP)
	Retrofit Only	Unshielded twisted pair (UTP)
Total wire length allowed with T Taps for Class B Wiring		Up to 10,000 ft (3 km), 0.58 µF

**Note:** For retrofit installations consult with your local Simplex product supplier, restrictions may apply.

**Table 5: IDNet 2 and IDNet 2+2 Wiring Specifications**

Specification	Description	
Wire Type	New Installation	Unshielded twisted pair (UTP)
	Retrofit Only	Shielded or unshielded, twisted or untwisted wire
Total wire length allowed with T Taps for Class B Wiring		Up to 12,500 ft (3.8 km), 0.60 µF

**Table 5: IDNet 2 and IDNet 2+2 Wiring Specifications**

Specification	Description
Maximum Capacitance Between IDNet 2 Channels	1 $\mu$ F
IDNet 2 and IDNet 2+2 Module Compatibility:	IDNet communicating devices and TrueAlarm sensors including QuickConnect and QuickConnect2 sensors

**Note:** For retrofit installations consult with your local Simplex product supplier, restrictions may apply.

## TrueAlarm system operation

Addressable device communications include operation of TrueAlarm smoke and temperature sensors. Smoke sensors transmit an output value based on their smoke chamber condition and the CPU maintains a current value, peak value, and an average value for each sensor. Status is determined by comparing the current sensor value to its average value. Tracking this average value as a continuously shifting reference point filters out environmental factors that cause shifts in sensitivity.

**Programmable sensitivity** of each sensor can be selected at the control panel for different levels of smoke obscuration shown directly in percent, or for specific heat detection levels. To evaluate whether the sensitivity has to be revised, the peak value is stored in memory and can be easily read and compared to the alarm threshold directly in percent.

**CO sensor bases** combine an electrolytic CO sensing module with a TrueAlarm analog sensor to provide a single multiple sensing assembly using one system address. The CO sensor can be enabled or disabled, used in LED or Switch modes and custom control, and can be made public for communication across a fire alarm Network. Refer to data sheet *S4098-0052* for details.

**TrueAlarm heat sensors** can be selected for fixed temperature detection, with or without rate-of-rise detection. Utility temperature sensing is also available, to provide freeze warnings or alert to HVAC system problems. Readings can selected as either Fahrenheit or Celsius.

### TrueSense early fire detection

Multi-sensor 4098-9754 provides photoelectric and heat sensor data using a single 4100ES IDNet address. The panel evaluates smoke activity, heat activity, and their combination, to provide TrueSense early detection. For more details on this operation, refer to data sheet *S4098-0024*.

## Diagnostics and default device type

### Sensor status

TrueAlarm operation allows the control panel to automatically indicate when a sensor is almost dirty, dirty, and excessively dirty. The NFPA 72 requirement for a test of the sensitivity range of the sensors is fulfilled by the ability of TrueAlarm operation to maintain the sensitivity level of each sensor. CO Sensors track their 10 year active life status providing indicators to assist with service planning. Indicators occur at: 1 year, 6 months, and when end of life is reached.

### Modular TrueAlarm sensors

TrueAlarm sensors use the same base and different sensor types (smoke or heat sensor) and can be easily interchanged to meet specific location requirements. You can substitute the intentional sensor during building construction when conditions are temporarily dusty. Instead of covering smoke sensors (causing them to be disabled), heat sensors can be installed without reprogramming the control panel. The control panel can indicate an incorrect sensor type, but the heat sensor can operate at a default sensitivity to provide heat detection for building protection at that location.

## IDNAC SLC for addressable notification appliance communications

**IDNAC addressable notification appliance communications** include operation of the following appliances:

- TrueAlert and TrueAlert ES Visible only (V/O, strobe)
- Audible only (A/O, horn)
- Audible/Visible (A/V, horn/strobe)
- Strobes of Speaker/Visible (S/V)

**Note:** S/V appliances require separate speaker wiring.

Operators can use the IDNAC SLC to control each horn and strobe individually through a single two-wire circuit. The IDNAC SLC confirms the wiring connections to the electronic circuit of each notification appliance, and then confirms communication between the fire alarm control unit and each appliance. Addressable communications increases supervision integrity versus conventional notification systems by providing supervision beyond the circuit wiring to each individual appliance and by constantly verifying the ability of each appliance to communicate with the control panel.

### Individual appliance status and settings

The fire alarm control panel monitors and records each addressable notification appliance status, type of appliance, and its configured appliance settings. A fault in any individual appliance automatically reports a trouble condition to the control panel.

**Figure 5: TrueAlert ES addressable appliance reference**

### Virtual NACs provide control convenience

For control convenience, operators can group IDNAC notification appliances into *Virtual NACs* (VNACs) for group control. You can make that grouping across SLCs, not defined by their wiring connection.

### Panel control convenience

Applicable operation settings for each appliance can be programmed *without having to replace appliances or remove them from the wall or ceiling*. An appliance's VNAC notification zone can be easily changed through programming without having to add additional circuits, conduit, and wiring. Audible and visible appliances for non-Fire Emergency Communications notification can be programmed to operate separately *on the same pair of wires as the fire alarm notification appliances*. The result is lower installation, retrofit, and overall life-cycle cost of ownership compared with traditional conventional notification systems.

### Installation, retrofit, and life-cycle cost benefits

With each addressable appliance capable of being controlled separately on the same two-wire IDNAC SLC, installation time and expense for both retrofit and new construction can be significantly reduced. When Class B wiring is used, wiring can be **T-tapped** allowing more savings in distance, wire, conduit (size and utilization), and overall installation efficiency.

### Location information, diagnostics and troubleshooting

Each addressable notification appliance has its own 40 character custom label to identify the location of the appliance and to aid in troubleshooting fault conditions. In conventional notification

---

systems, conventional appliances are not capable of communicating with the control panel. Fault reporting on a conventional system is limited to the circuit wiring and the entire area (zone) covered by appliances on the notification appliance circuit (NAC) making it much more difficult and costly to locate and correct the source of a problem. Using the TrueAlert *magnet* test allows each appliance to individually identify its candela setting and address and to briefly operate if desired, and using the ***TrueAlert ES appliance Self-Test feature provides detailed performance verification for each appliance***.

## TrueAlert ES appliance Self-Test operation

### Onboard test sensors

For efficient and unobtrusive Self-Testing TrueAlert ES appliances are equipped with onboard sensors to detect strobe or horn output. When **Automatic Self-Test** is initiated from the control panel, each appliance in the selected VNAC group briefly operates and then reports its Self-Test status to the control panel, all in several seconds. If required you can select Silent Self-Test to test only visible appliance. The control panel is in a trouble condition during testing and in the event of an alarm, Self-Test is automatically terminated. Additionally, **Automatic Self-Test can be scheduled** to occur at a convenient time on a regular basis.

**Note:** Requires version 2.03.01 or higher software.

### Automatic Self-Test

Automatic Self-Test results are communicated to the control panel with a time and date stamp and are stored in memory. Results are viewable at the front panel display and printed reports can be generated from the panel service port.

### Individual Self-Test

Individual Self-Test is selected from the control panel when individual appliances need to be observed to operate. Each appliance in the selected VNAC group turns on its LED until individually activated by applying a magnet. After performing the individual test, the appliance LED turns off to indicate completion. Results are recorded the same as during the automatic test.

**TrueAlert ES appliance Self-Test last test results report example****Figure 6: TrueAlertES Self-Test report**

Service Port					Page 1
REPORT 10 TrueAlertES Self-Test Report					12:34:56pm WED 03-DEC-14
Point ID	Custom Label	Date	Visual	Audible	
T1-1-1	VO FIRST FLOOR (up to 40 characters)	03-DEC-14	NO OUT	N/A	
T1-2-5	AV FIRST FLOOR EAST WING	03-DEC-14	NO OUT	NORMAL	
T7-3-55	AO SECOND FLOOR EAST WING	03-DEC-14	N/A	NO OUT	
T8-2-45	AV SECOND FLOOR ROOM 29	03-DEC-14	NOT TST	N/A	
T8-2-60	AV SECOND FLOOR ROOM 22	03-DEC-14	NORMAL	NORMAL	
T1-2-4	AO FIRST FLOOR ROOM 17	03-DEC-14	N/A	UNSUPP	
TRUEALERT_ES SELF-TEST REPORT COMPLETED					
Press RETURN for next Screen OR CTRL-X to abort					

**Results Description**

- **NORMAL** = Works correctly
- **NO OUT** = No Output, no light or sound was detected
- **NOT TST** = No result. Either the appliance did not return a result before the test ended or the test was conducted as silent (strobes only) and audible appliance was not activated
- **N/A** = Not applicable (no strobe, on audible only)
- **UNSUPP** = Appliance not compatible with Self-Test (TrueAlert addressable appliance not TrueAlert ES addressable appliance)

**Note:** Additional TrueAlert ES Self-Test information is detailed in ES Operating Instructions 579-197 shipped with the panel.

**TrueAlert ES appliance Self-Test all test results report example****Figure 7: TrueAlertES Self-Test report**

Service Port					Page 1
REPORT 10 TrueAlertES Self-Test Report					12:34:56pm WED 03-DEC-14
Point ID	Custom Label	Date	Visual	Audible	
T1-1-1	VO FIRST FLOOR	03-DEC-14	NO OUT	N/A	
T1-2-5	AV FIRST FLOOR EAST WING	03-DEC-14	NO OUT	NORMAL	
T1-2-6	AV FIRST FLOOR NORTH ENTRANCE	30-OCT-14	NO OUT	NORMAL	
T7-3-55	AO SECOND FLOOR EAST WING	03-DEC-14	N/A	NO OUT	
T8-2-45	AV SECOND FLOOR ROOM 29	03-DEC-14	NOT TST	N/A	
T1-1-11	AV FIRST FLOOR SOUTH ENTRANCE	30-OCT-14	NORMAL	NORMAL	
T8-2-60	AV SECOND FLOOR ROOM 22	03-DEC-14	NORMAL	NORMAL	
T1-2-4	AO FIRST FLOOR ROOM 17	03-DEC-14	N/A	UNSUPP	
T1-2-7	AO FIRST FLOOR ROOM 12	30-OCT-14	N/A	UNSUPP	
T8-3-43	AV SECOND FLOOR ROOM 25	30-OCT-14	UNSUPP	UNSUPP	
TRUEALERT_ES SELF-TEST REPORT COMPLETED					
Press RETURN for next Screen OR CTRL-X to abort					

**TrueAlert ES appliance Self-Test individual appliance report example****Figure 8: Appliance report**

CUSTOM LABEL	
4-1-2	AV
POINT ADDRESS: 4-1-2	Type: AV
CARD: 4 CHANNEL: 1 DEVICE: 2	
EXTENDED POWER SUPPLY	
UNIT NUMBER: 2	RUI NUMBER: LOCAL
PRIMARY STATUS	NORMAL
AUDIBLE GROUP CONFIG:	0 0 0
VISUAL GROUP CONFIG:	0 0 0
STYLE:	INDOOR
OPERATION:	GENERAL EVAC
CANDELA RATING	15 CD
COLOR LENS	YES
TONE TYPE	BROADBAND
CODING TYPE	TEMPORAL
VOLUME	HIGH
LAST TEST TIME:	MON 02-JUN-14 01:00 AM
LAST VISUAL TEST:	NORMAL
LAST AUDIBLE TEST:	NORMAL
LAST TEST VOLUME:	NORMAL
DEVICE TEST TROUBLE:	NORMAL

**IDNAC SLC hardware reference****ES-PS power supplies**

ES-PS power supplies configured with an IDNAC card provide three, 3 A IDNAC SLCs for control and power to TrueAlert ES and TrueAlert addressable notification appliances. Both power supplies incorporate an efficient switching design that provides a regulated output of 29 VDC, even during battery operation. With 29 VDC minimum output at the panel, addressable notification SLCs can support wiring distances two to three times farther than available with conventional notification, or support more appliances for each SLC, or work with smaller gauge wiring, or combinations of these benefits, all resulting in installation and maintenance savings with high assurance that appliances that operate during normal system testing can operate during worst case alarm conditions.

**IDNAC SLC appliance wiring reference****IDNAC SLC capacity**

Up to 127 addresses and up to 139 unit loads. Appliances are typically one unit load. Devices such as Isolators may require more than one load. For specific information refer to individual device data sheet.

**Table 6: IDNAC SLC appliance wiring reference**

Specification	Rating
Required wire type	Unshielded twisted pair (UTP)
Maximum wire length allowed with T-Taps for Class B wiring, for each SLC	10,000 ft (3048 m)
Maximum wire length for each SLC to any appliance	4000 ft (1219 m)
Appliance supervisory current	1 unit load = 0.8 mA for each appliance
Wiring connections	Terminals for 18 to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> )
Installation Instructions (see for more information)	579-1015

**8-Point Zone/Relay Module details****• Select as IDC or Relay and configure:**

- Up to eight Class B IDCs or up to four Class A IDCs
- Up to eight Relay outputs rated 2 A resistive at 30 VDC (N.O. or N.C.)
- Combinations of IDCs and Relays.

**Note:** Each zone is separately configurable as an IDC or Relay output.


**• IDC Support:** each IDC supports up to 30, two-wire devices. Zone relay modules can be powered directly from the control unit power supply or through the optional 25 VDC regulator module where required for two-wire detector compatibility. Refer to 2-Wire Detector Compatibility document 579-832 for additional details.

**• IDC EOL resistor values are selectable as:** 3.3 kΩ, 2 kΩ, 2.2 kΩ, 3.4 kΩ, 3.9 kΩ, 4.7 kΩ, 5.1 kΩ, 5.6 kΩ, 6.34/6.8 kΩ, and 3.6 kΩ + 1.1 kΩ. See instructions for more details.

## Color ES Touch Screen Display

The Color ES Touch Screen Display interface offers intuitive operation similar to a tablet or smart phone. With a larger area format versus an individual text line display, more information is available at a glance, and minimal key presses are needed to access detailed information.

Figure 9: ES Touch Screen Display operator interface

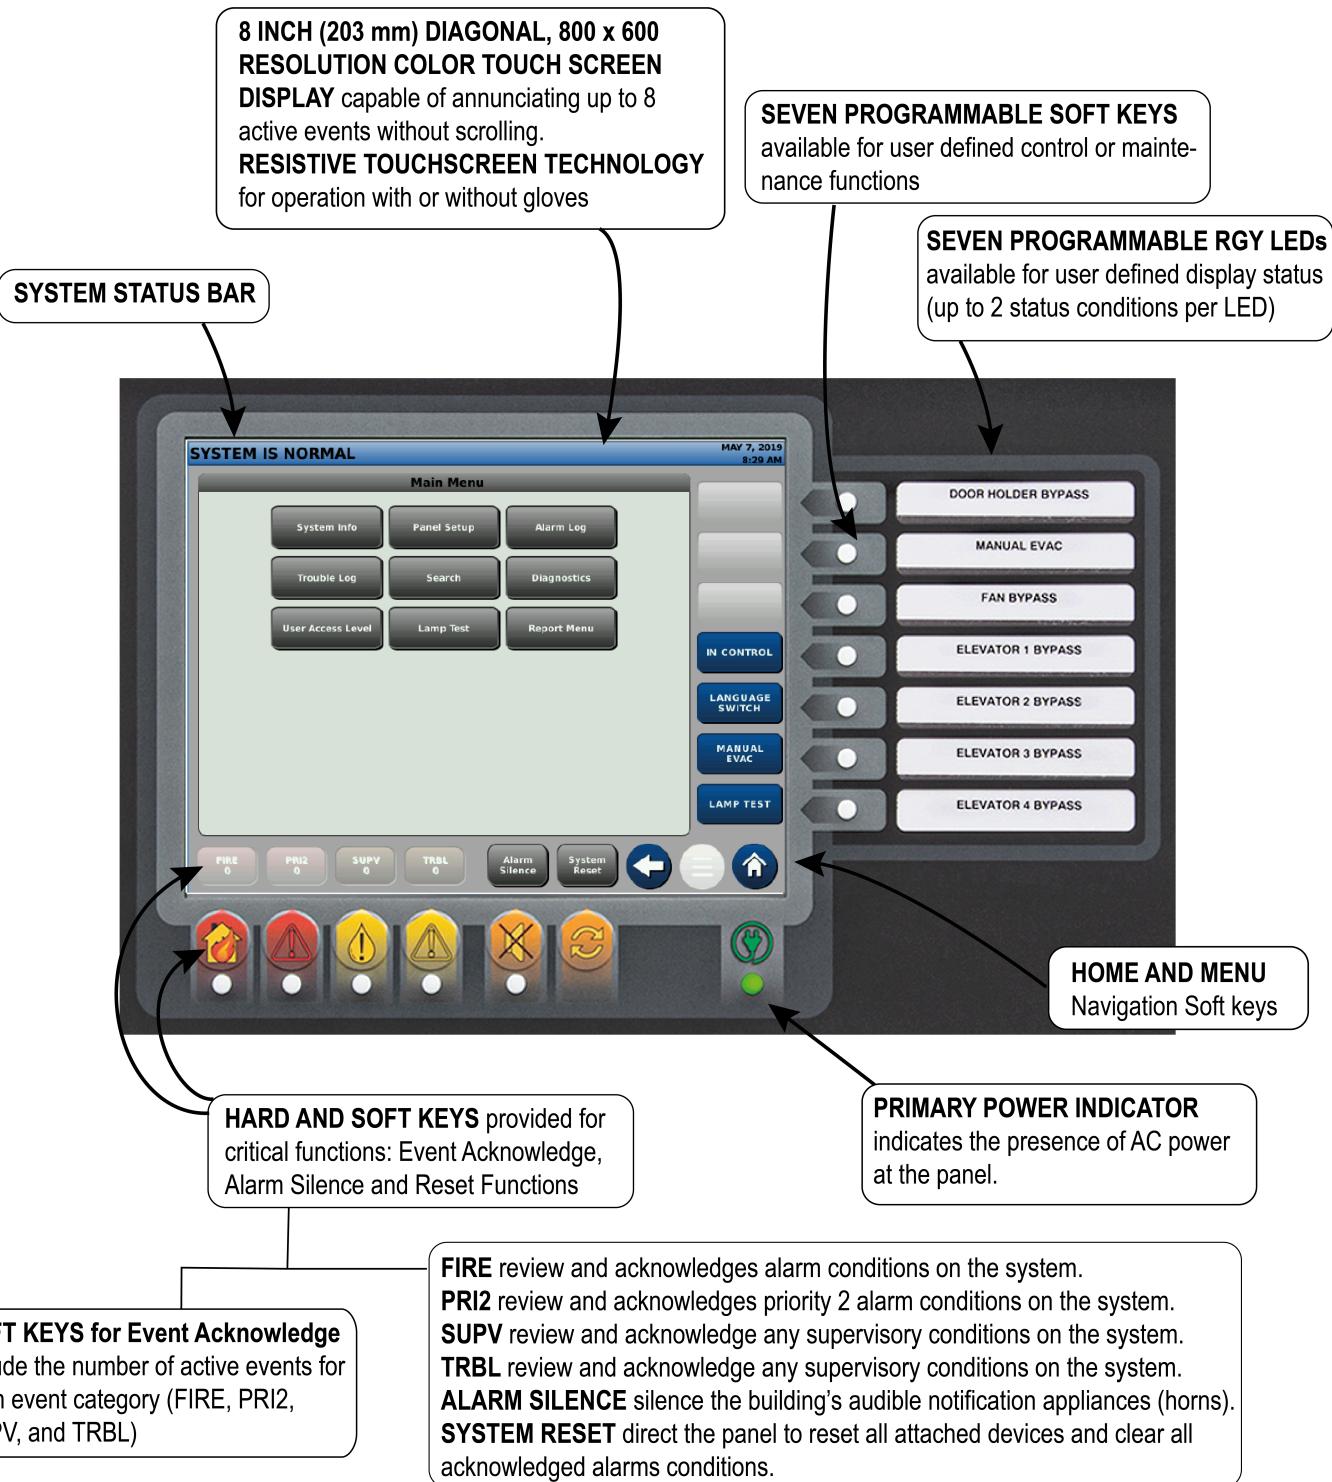

## Features

### ES Touch Screen Displays provide customized operating experience

- Event activity display choices include: First 8 Events or First 7 Events with emphasis on Most Recent, or First 6 Events with emphasis on First and Most Recent (individually selectable for each event type).
- System reports are easily viewable. Logs can be read with minimal scrolling.

- Up to two languages are available for a system, easily selected by programmable key press.
- Information sent to Remote ES Touch Screen Displays can be vectored by point or zone.
- Both Hard and Soft keys available for critical functions: Event Acknowledge, Alarm Silence, and Reset Functions.
- Resistive touchscreen technology allows operation with or without gloves.
- Seven programmable RGY LEDs available for user-defined display status (up to 2 status conditions for a LED).
- Seven programmable Soft keys available for user-defined control or maintenance functions.
- PRI2 Soft key label can be changed to CO to annunciate Carbon Monoxide detection status.
- ES Touch Screen Display can be programmed to report individual points or groups of points as a single zone.
- Supports ability to display a custom watermark background file of a company logo or other display content.
- Seismically compliant under the State of California Statewide Office of Housing and Development (OSHPD) Special Seismic Certification (SSC) program guidelines. Refer to *Simplex Seismic Application Guide 579-1213* and *Battery Brackets for Seismic Activity Applications S2081-0019* for details.

#### Display properties

- 8 inch (203 mm) diagonal, 800 x 600 resolution color touch screen display capable of annunciating up to 8 active events without scrolling.
- Bright white LED backlighting provides efficient and long lasting illumination. Backlight is dim in quiescent state, automatically switches to full power on touch or on event activity in system.

#### Description

ES Touch Screen Displays for 4100ES fire alarm systems provide a large display with extended information content, dual language support including UTF-8 character languages, and an intuitive control key interface with the following:

- Up to 10 ES Touch Screen Displays are supported for each 4100ES control panel. Able to allow one ES Touch Screen Display to take-control and to designate access levels for interfaces not in-control. Programmable LEDs can be assigned to in-control status indications.
- Menu-driven format conveniently prompts operators for the next action required.
- Direct point callup displays individual points alphabetically and then homes in on the logical choice as more point information is entered.
- Event categories are color coded for quick visual representation:
  - Red for Alarm and Priority 2 Events
  - Yellow for Supervisory and Trouble events.
- Date formats are either MM/DD/YY or DD/MM/YY.
- Time formats are either 24 hour or 12 hour with AM/PM.
- System Normal screen supports a color background (watermark) for company name, company logo, or other display content.

## Example display screens

Table 7: Example display screens

Figure 10: First and most recent alarm display

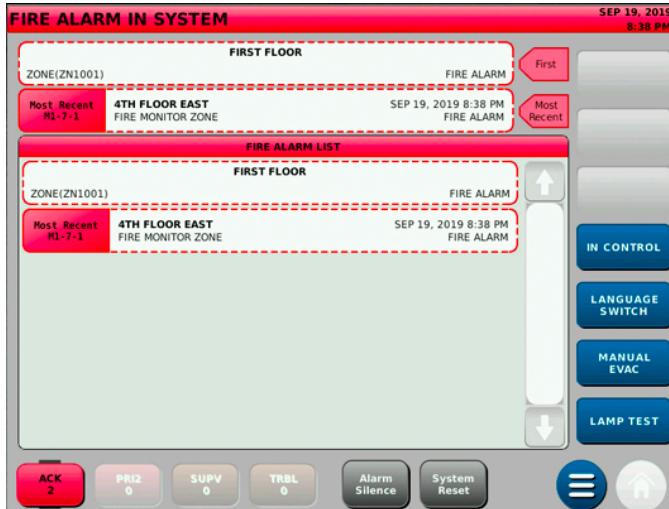


Figure 12: First eight active trouble events list



Figure 14: Alarm history log

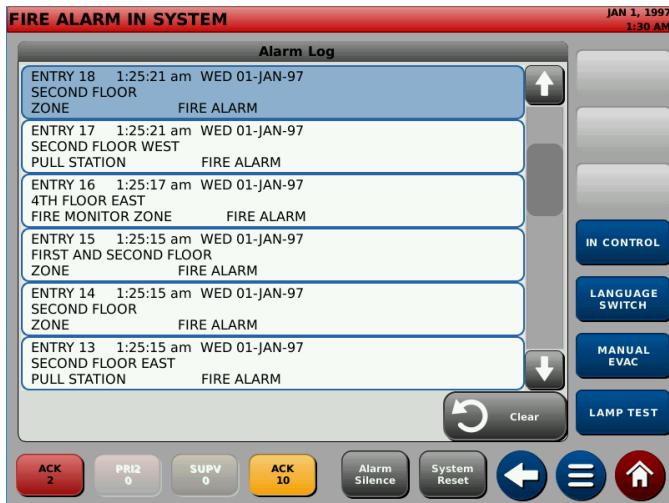


Figure 11: Main menu

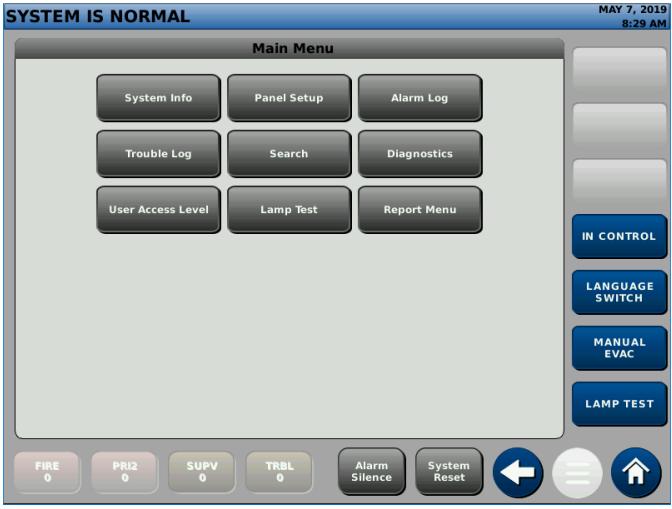


Figure 13: Direct point callup


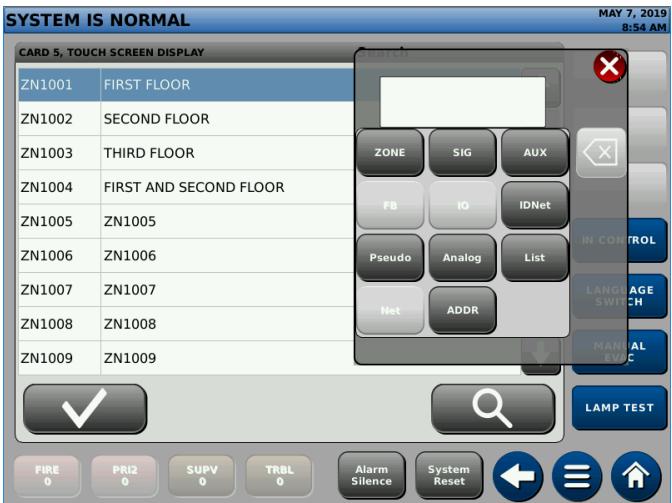


Figure 15: Detailed point status screen for TrueAlert ES appliance

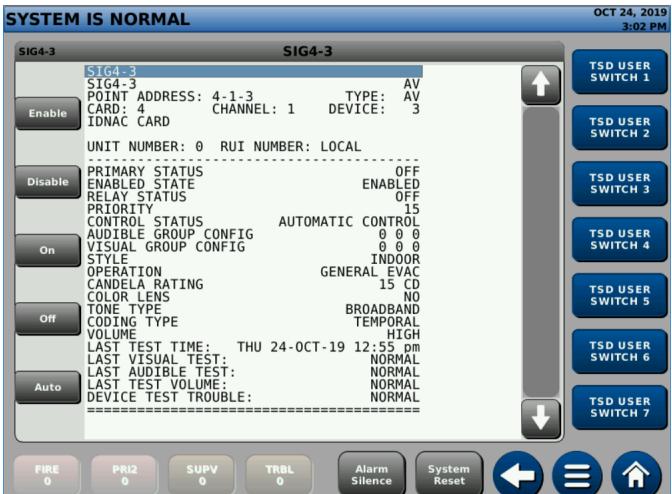

**Specifications****Table 8: General ES Touch Screen Display specifications**

<b>Specification</b>	<b>Rating</b>
Resolution	800 x 600 Pixels (RGB)
Size / Type	8 in. (203 mm) Diagonal / Color Touch Screen
Touch Screen technology	Resistive
Event display	Up to 8 events without scrolling
Normal Screen custom watermark file format	680 x 484 Pixels: BMP, JPG, TIFF, GIF or PNG file format
Environmental	Operating temperature: 32°F to 120°F (0°C to 49°C) Operating humidity: Up to 93% RH, non-condensing at 90°F (32°C) maximum


## Operator interface with monochrome 2 x 40 LCD

With the locking door closed, the glass window allows viewing of the display, status LEDs, and available operator switches. Features include a two-line by 40-character, wide viewing angle (super-twist) LCD with status LEDs and switches as shown in [Figure 16](#).

LED indicators describe the general category of activity being displayed with the LCD providing more detail. For the authorized user, unlocking the door provides access to the control switches and allows further inquiry by scrolling the display for additional detail.


- Convenient and extensive operator information is provided using a logical, menu-driven display
- Multiple automatic and manual diagnostics for maintenance reduction
- Alarm and Trouble History Logs (up to 1000 entries for each, 2000 total events) are available for viewing from the LCD, or capable of being printed to a connected printer, or downloaded to a service computer
- Convenient PC programmer label editing
- Password access control

**Figure 16: Operator interface**

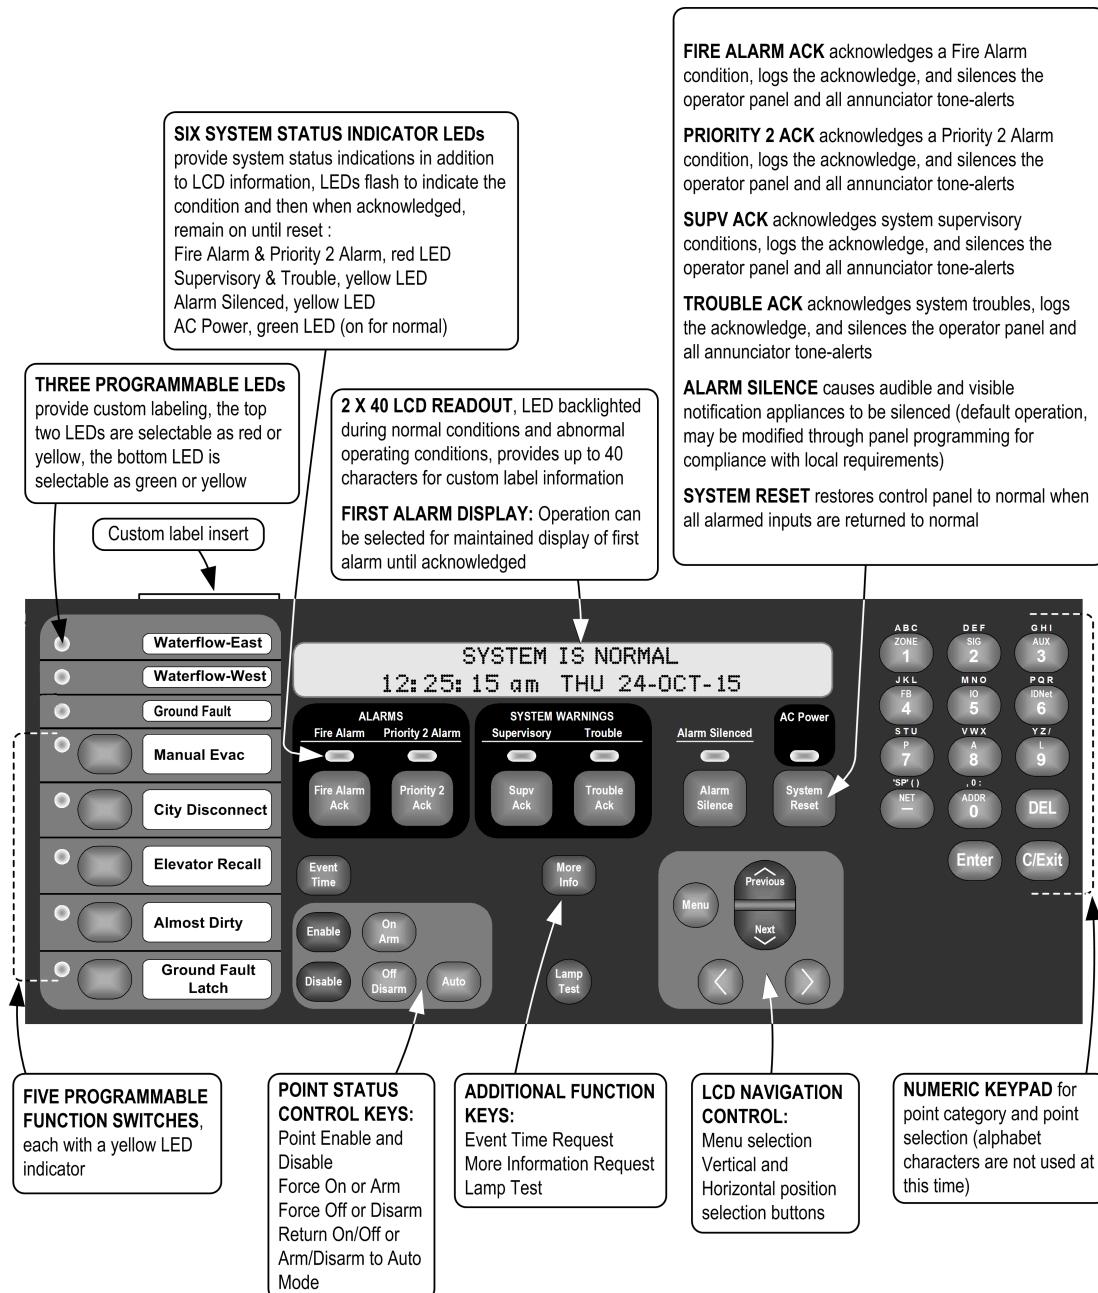

## Expansion Bay module loading reference

Figure 17: Expansion Bay chassis

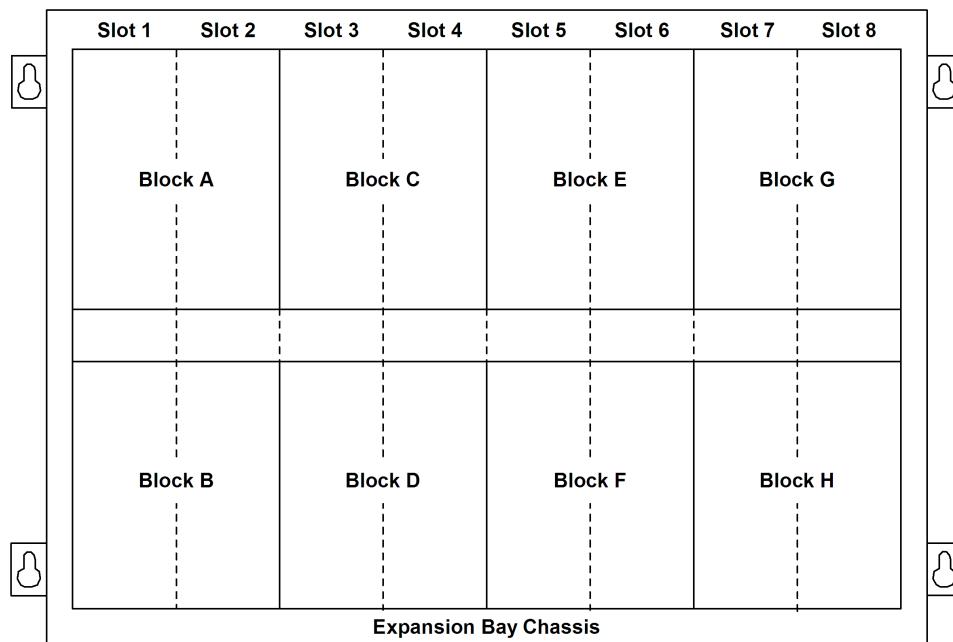

**Size definitions:** Block = 4 in. W x 5 in. H (102 mm x 127 mm) card area


Slot = 2 in. W x 8 in. H (51 mm x 203 mm) motherboard with daughter card

Table 9: Expansion Bay loading reference

Description	Mounting
IDNet 2, IDNet 2+2 Modules	1 Block
Four 2 A Relays	1 Block
Four 10 A Relays	4 in., 2 Slots
Eight 3 A Relays	1 Block
VESDA Interface	2 in., 1 Slot
Class B IDC	2 in., 1 Slot
Class A IDC	2 in., 1 Slot
MAPNET II Module	4 in., 2 Slots
MAPNET II/IDNet Isolator	2 in., 1 Slot
NAC Card	1 Block
IDNAC Card	2 Blocks (on ES Power Supply only)
ES-PS	Blocks G and H ONLY
ES-PS Configured as backup	Blocks E and F ONLY
ES-XPS	2 Blocks

## Mounting and Master Controller Bay module reference

Figure 18: Mounting and CPU Bay module reference

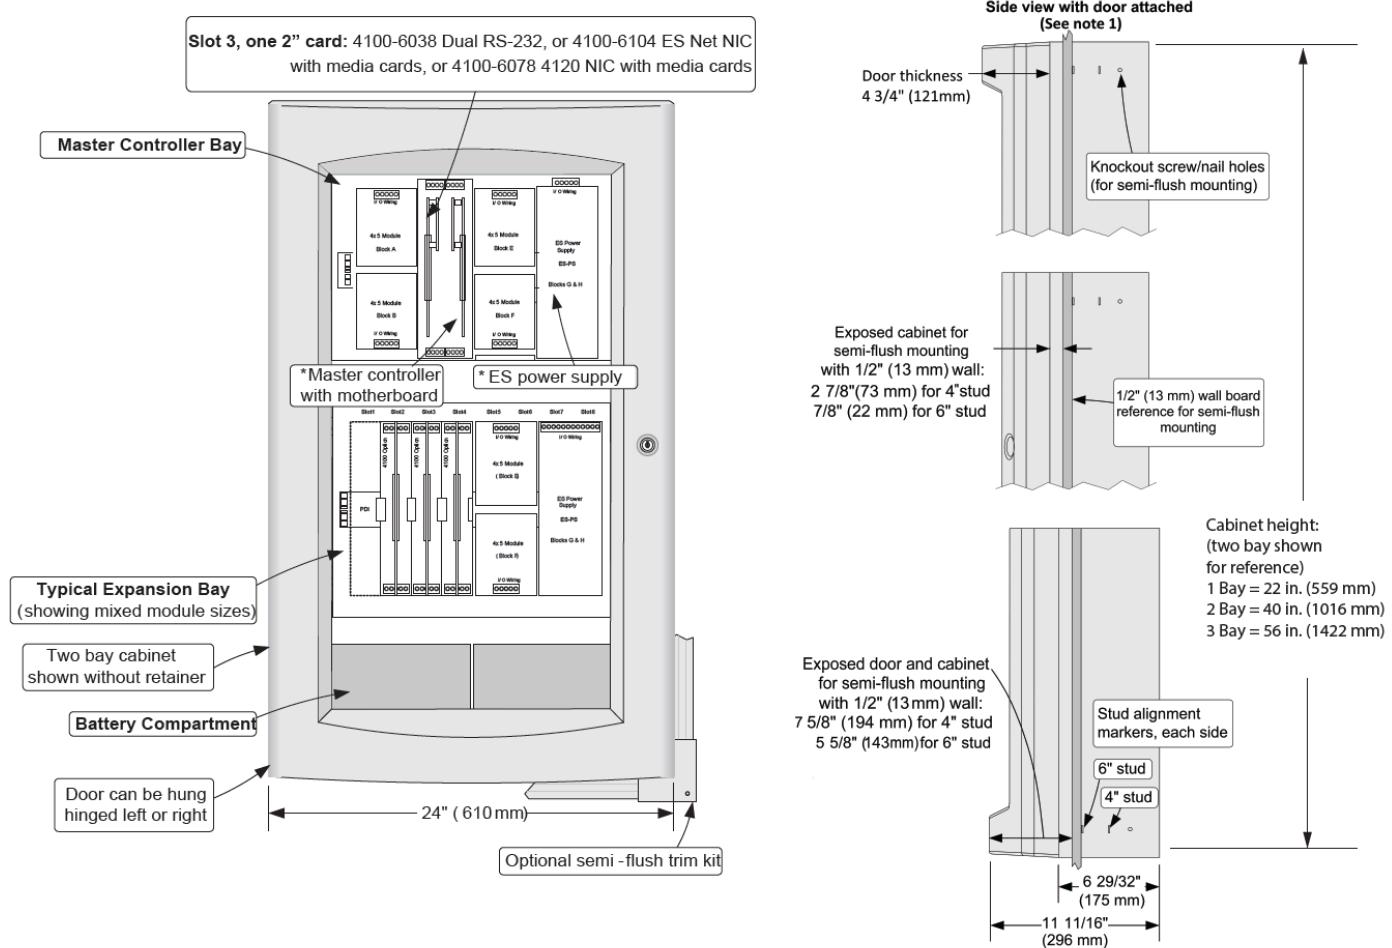

### Note:

1. Side View dimensions are shown with minimal cabinet and door protrusion from the exterior wall. For 6 in. stud construction with minimum protrusion shown, the door opens 90 degrees. To allow the door to open 180 degrees, the exposed cabinet dimension from the exterior wall must be a minimum of 3 in. (76 mm) for both 4 in. and 6 in. stud construction.
2. Asterisks (\*) in Figure 18 indicate supplied modules.
3. A system ground must be provided for earth detection and transient protection devices. This connection can be made to an approved, dedicated earth connection for each NFPA 70, article 250, and NFPA 780.

## General specifications

Table 10: ES Power Supply specifications (ES-PS and ES-XPS)

Specifications	Rating
<b>AC input power</b>	120 to 240 VAC
120 VAC	3.72 A
220 to 240 VAC	1.82 A
<b>Total DC output power capacity</b>	
Without fan	9.5 A
With 4100-5131 fan and 4100-5451 IDNAC module(s)	9.7 A
With 4100-5131 fan (without 4100-5451 IDNAC module)	12.7 A
With Regulated 24V appliance loads (with or without 4100-5131 fan)	5.0 A
<b>Special application appliance loads:</b> supports full total DC output power capacity ratings	Simplex horns, strobes, and combination horn/strobes and speaker/strobes (contact your Simplex product representative for compatible appliances)
<b>Regulated 24V appliances:</b> reduces total DC output power capacity to 5.0 A	Power for other UL listed appliances. Use associated external synchronization modules where required.
<b>Auxiliary power tap</b>	2 A maximum (taken from total output power capacity)
<b>NACs programmed for auxiliary power</b>	3 A maximum for each NAC, 5 A maximum total (taken from total output power capacity)
<b>Battery charger (ES-PS only)</b>	Sealed lead-acid batteries
Battery Ah capacity	UL/ULC listed for battery charging of up to 110 Ah (batteries larger than 50 Ah require a remote battery cabinet)
Charger characteristics and performance	Temperature compensated, dual rate, recharges depleted batteries in 48 hours
<b>Environmental</b>	
Operating Temperature	32°F to 120°F (0°C to 49°C)
Operating Humidity	Up to 93% RH, non-condensing at 90°F (32°C) maximum
<b>Option Card Mounting</b>	2 vertical blocks are available for compatible modules. Refer to 579-1288 installation instructions for additional details.

### Note:

1. Battery charger is only available on the ES-PS Power Supply.
2. When an ES-PS is used to power Flex-35 or Flex-50 Amplifiers the ES-PS battery charger is not available.

## Master Controller Selection information

### Note for Table 11 and Table 12

Supervisory and alarm currents are without IDNet devices. Add IDNet device currents separately.

Table 11: 4100ES Master Controller Selection

Model	Description	Includes	Listings	Supv.	Alarm
4100-9701	ES-PS Master Controller with 2x40 Display - English	Master Controller - English, 2x40 Display, CPU Card, IDNet 2 Card supports up to 250 addressable/analog points, ES Power Supply (120 V to 240 V 50/60 Hz, 24 V Aux. Relay, 24 V Aux. Power Tap/Single NAC, 110 Ah Battery Charger) and external RUI+ (isolated or un-isolated) communications interface.	UL/ULC	277 mA (See note)	321 mA (See note)
4100-9702	ES-PS Master Controller with 2x40 Display - Canadian French	Same as 4100-9701 except with Canadian French user interface.	ULC		
4100-9706	ES-PS Master Controller with ES Touch Screen Display	Same as 4100-9701 except with Color ES Touch Screen Display user interface. For dual language support, desired language is switch selectable.	UL/ULC, CSFM	362 mA (See note)	441 mA (See note)
4100-9709	ES-PS Master Controller without Display - English	Same as 4100-9701 except with no 2x40 Display or user interface.	UL/ULC	277 mA (See note)	321 mA (See note)

### Note:

1. The Master Controller current draw specifications do not include IDNet, NAC, or IDNAC current draws. These must be added separately as required.
2. International orders may substitute MX Loop Module (4100-3120) in place of IDNet 2 Module (4100-3117). Refer to data sheet S4100-0059 for more details. The 4100-3120 provides the same module and specifications as the 4100-6311 but is dedicated as a Master Controller feature selection.
3. At the time of publication English and Canadian French languages are available for ES Touch Screen Display models. Contact your local Simplex product supplier for the latest status and availability for other languages.

**Table 12: 4100ES Master Controller upgrades for existing 4100 series Fire Alarm Control Panels**

<b>Model</b>	<b>Panel Type</b>	<b>Includes</b>
4100-7150	1000 pt 4100 (4100+)	New Master Controller CPU card, 4100ES door assembly with 2 x 40 LCD operator interface, and Ethernet connection
4100-7152	512 pt 4100	Same as 4100-7150 plus a Universal Power Supply
4100-7158	4100U or 1000 pt 4100 (4100+) previously upgraded to 4100U	New Master Controller CPU card with Ethernet Connection Upgrade Kit (door assembly with user interface not included) for: 4100U with or without operator interface, or 4100+ and operator interface, or an existing 4100 (512 pt) or 4100+ (1000 pt) panel that was previously upgraded to a 4100U Master Controller and operator interface
4100-7162	1000 pt 4100 (4100+)	New Master Controller CPU card, 4100ES door assembly with Color ES Touch Screen Display user interface and Ethernet connection for 4100+ cabinet (requires 4100ES Version 6.01 or higher)
4100-7163	4100+ Cabinet upgraded with New Master Controller CPU card	4100ES door assembly with Color ES Touch Screen Display user interface and Ethernet connection for 4100+ cabinet previously upgraded with New Master Controller CPU card (requires 4100ES Version 6.01 or higher)
4100-7164	2000 pt 4100 (4100U)	New Master Controller CPU card, 4100ES door assembly with Color ES Touch Screen Display user interface and Ethernet connection for 4100U cabinet (requires 4100ES Version 6.01 or higher)

**Table 13: ES Touch Screen Display user interface upgrade kit**

<b>Model</b>	<b>Panel type</b>	<b>Description</b>
4100-7165	4100ES or 4010ES	New ES Touch Screen Display user interface for upgrading an existing 4100ES 2x40 LCD or InfoAlarm user interface, or for upgrading an existing 4010ES InfoAlarm User Interface to a new ES Touch Screen Display user interface

**Table 14: Master Controller accessories**

Model	Description
4100-2300	Expansion Bay Assembly, order for each required expansion bay.
4100-2303	Legacy Module Stabilizer Bracket, used when expansion bays have legacy slot style modules
4100-2301	Expansion Bay upgrade kit for mounting 4100ES style (4 in. x 5 in. modules) in existing 4100 style panels <b>Note:</b> When using this kit to upgrade a 4100+ transponder, a 4100-0620 Transponder Interface Card (TIC) is also required for communications to the 4100ES module

## Module Selection Information

### Current Calculation Notes

To determine total supervisory current, add currents of modules in panel to base system value and all external loads powered by panel power supplies.

To determine total alarm current, add currents of modules in panel to base system alarm current and add all panel NAC loads and all external loads powered from panel power supplies.

**Table 15: Communication Modules**

Model	Description	Size	Supv.	Alarm
4100-1291	Un-isolated remote unit interface module (RUI), up to three maximum for each control panel	1 Slot	85 mA	85 mA
4100-6031	<b>Select one for each</b> City Circuit, with disconnect switches	For use with ES-PS only (not for backup ES-PS or ES-XPS)	20 mA	36 mA
4100-6032	City Circuit, without disconnect switches		20 mA	36 mA
4100-6033	ES Power Supply (non power-limited)	1 Block	15 mA	37 mA
4100-6038	Dual Port RS-232 with 2120 interface (slot module)	Three maximum of RS-232 type modules for each panel	1 Slot	132 mA
4100-6048	VESDA Aspiration System Interface		1 Slot	132 mA
4100-6080	DACT, Point or Event Reporting. One shipped unless 4100-7908 is selected. Two max. for each system, includes two 2080-9047 cables, 14 ft (4.3 m) long, RJ45 plug and spade lugs.	Side Mt.	30 mA	40 mA

**Table 16: Redundant CPU ES net Conversion Kit**

Model	Description	Includes
4100-7170	Redundant CPU ES net Conversion Kit <b>Note:</b> Compatible with 4100-9706 ES-PS Master controller with ES Touch Screen Display	<ul style="list-style-type: none"> <li>NXP main CPU controller board</li> <li>CPU switcher card assembly</li> <li>Expansion bay assembly</li> <li>Harnesses</li> </ul>

**Table 17: Connected Services Gateway with IP communicator**

Model	Description	Size
4100-2504	Connected Services Gateway with IP communicator, side mount	1 slot
4100-2506	Connected Services Gateway with IP communicator, vertical mount	2 blocks

**Table 18: ES Power Supplies**

Model	Voltage	Description	Includes	Provides Power to Bay	Size	Supv.	Alarm
4100-5401	120 to 240 V 50/60 Hz	ES-PS	24 V Aux. Relay, 24 V Aux. Power 2 A Tap/ Simple NAC, 110 Ah Battery Charger, 2 PDI Blocks for compatible option cards.	Yes	2 Blocks	68 mA	77 mA
4100-5402	120 to 240 V 50/60 Hz	ES-XPS	Same as ES-PS, except without battery charger	No			

**Table 19: Power supply accessories**

Model	Description	Size	Current
4100-5152	12 VDC Power Option, 2 A maximum	1 Block	1.5 A maximum
4100-0156	8 VDC Converter, required for multiple Physical Bridge Modules, 3 A maximum	1 Block	included with loads
4100-5130	Voltage Regulator Module, 22.8 to 26.4 VDC (25 VDC nominal); isolated and resettable output; includes earth detection circuit and trouble relay for status monitoring.	1 Block	3 A maximum with 2.5 A load, 4.9 A maximum with 4 A load
4100-5131	ES-PS Fan Module, allows more than one power supply to be installed in a single bay and may increase total DC output power capacity for each power supply. See <b>Table 10</b> for specifications.	N/A	0 mA Supv. 200 mA Alarm
4100-0636	Box Interconnection Harness Kit (non-audio); order one for each close-nipped cabinet		

**Table 19: Power supply accessories**

Model	Description	Size	Current
4100-0638	4100 Slot Module Additional 24 VDC Harness; needed when 4100 Slot module requirements exceed 2 A from ES-PS		
4100-5403	Harness for ES-PS Backup Power Supply		
4100-0644	120 VAC PDM Harness		One PDM harness is required for each power supply, select as required for appropriate input voltage
4100-0645	220 VAC PDM Harness		
4100-0646	230 VAC PDM Harness		
4100-0647	240 VAC PDM Harness		

**Table 20: Conventional and Addressable Notification Appliance Modules**

Model	Description	Outputs	Size	Max Load - Special Application		Max Load - Regulated 24 V		Current Draw	
				On ES-PS / ES-XPS	In Bay	On ES-PS / ES-XPS	In Bay	Supv.	Alarm
4100-5450	Conventional NAC Module	Three 3 A NACs	1 Block	3.0 A / NAC 9.0 A / Card	3.0 A / NAC 6.0 A / Card	2.0 A / NAC 5.0 A / Card	2.0 A / NAC 2.0 A / Card	66 mA	66 mA
4100-5451	IDNAC Addressable Notification SLC Module	Three 3 A SLCs	2 Blocks (on ES Power Supply only)	3.0 A / NAC 9.0 A / Card	N/A	N/A		124 mA	230 mA

**Note:**

- Special Application specifications apply to both Special Application and Steady Aux Power loads during alarm operation. Available power during non-alarm operation is 5.0 A maximum.
- The 4100-5450 and 4100-5451 can only be powered from a 4100-5401 and 4100-5402 power supply.

**Table 21: Dual Class A Isolator for IDNAC**

Model	Description	Size	Supv.	Alarm
4100-6103	<b>Dual Class A IDNAC Isolator (DCAI):</b> <ul style="list-style-type: none"> <li>Converts a single Class B IDNAC SLC input to two Class A SLC outputs</li> <li>Provides short circuit isolation between each Class A output circuit</li> <li>Connect up to two DCAI Modules for each IDNAC SLC input up to a maximum of 6 DCAI Modules for each IDNAC SLC</li> <li>Each isolated output SLC used requires one IDNAC address</li> <li>The total current remains controlled by the Class B input source SLC at 3 A maximum</li> <li>Each isolated loop supports up to 30 device addresses</li> </ul> <p><b>Note:</b> You can install up to 30 additional device addresses between each 4905-9929 TrueAlert Addressable Isolator+ Module, not to exceed the maximum address and unit loading specifications for the IDNAC channel</p>	1 Block	8.3 mA	18.5 mA

**Table 22: 8-Point Zone/Relay Card**

Model	Description	Size	Supv.	Alarm
4100-5013	8 point zone/relay 4 in. x 5 in. flat module. Supports eight Class B or four Class A IDCs. Mounts in any open block in a master controller or expansion bay. Alarm current shown is for eight Class B IDCs using 3.3K end-of-line-resistors with four in alarm and four in standby. Standby current shown is for all eight IDCs in standby. Refer to 579-1236 Zone/Relay Module Installation Instructions for additional information.	1 Block	83 mA	295 mA
4100-6305	25 V regulator harness for 8 point zone/relay module. One required for each 8 point zone/relay module to be powered by the 4100-5130 25 V regulator module. A maximum of five 8 point zone/relay modules may be powered from the 4100-5130 for each bay.	N/A	N/A	N/A

**Note:** Modules in Table 22 requires 4100ES Version 3.06 or later.

**Table 23: IDNet Addressable Interface Modules**

Model	Description	Devices	Standby	Alarm
4100-3109	IDNet 2 Module, 250 point capacity. Electrically isolated output with two short circuit isolating Class B or Class A output loops, 1 block. Standard on ES-PS with IDNet 2 Module. Alarm currents for 50 and above devices includes 20 device LEDs in alarm.	none	50 mA	60 mA
4100-3117		50	90 mA	150 mA
		125	150 mA	225 mA
		250	250 mA	350 mA
4100-3110	IDNet 2+2 Module, 250 point capacity. Electrically isolated output with four short circuit isolating Class B or Class A output loops, one block. Alarm currents for 50 and above devices includes 20 device LEDs in alarm.	none	50 mA	60 mA
		50	90 mA	150 mA
		125	150 mA	225 mA
		250	250 mA	350 mA
4100-3111	IDNet Short Circuit Isolating Loop Output Module. Mount up to two on a 4100-3109 or 4100-3117 module. This option is for aftermarket field installation only. Total initiating SLCs for each CPU, including VESDA Interface is 30.			

**Note:** Each IDNet 2 and IDNet 2+2 Short Circuit Isolating Loop Output can be individually controlled for system diagnostics and can be assigned a public point for Fire Alarm Network.

**Table 24: Current draw for each IDNet device**

Condition	Current
Standby	0.8 mA
Alarm, with LED off	1.0 mA
Alarm, with LED on	3.0 mA

**Note:** A maximum of 20 devices with LED on is supported for each channel. Additional device LEDs do not turn on.

**Table 25: MAPNET Addressable Interface Modules**

Model	Description	Supv.	Alarm
4100-3102	MAPNET II Module, 127 point capacity, add devices separately. Module size = 2 Slots. Loading for each MAPNET II device = 1.7 mA.	Module without devices 255 mA Fully loaded module, total 471 mA	275 mA 491 mA
4100-3103	Isolator Module for MAPNET II communications; converts a single connected SLC into four isolated outputs selectable as Class A or Class B. Up to two Isolator Modules can be connected to one SLC. Module size = 1 Slot. <b>Note:</b> Compatible with MAPNET II Remote Isolators only	50 mA	50 mA

**Table 26: Relay Modules; Non power-limited for mounting in expansion bay only**

Model	Description	Resistive Ratings	Inductive Ratings	Size	Supv.	Alarm
4100-3207	Four double-pole, double-throw (DPDT) switches with feedback	2 A 30 VDC or 30VAC	0.5 A 30 VDC or 120 VAC	1 Block	18 mA	65 mA
4100-3208	Four double-pole, double-throw (DPDT) switches with feedback	10 A 30 VDC or 120 VAC or 240 VAC	10 A 30 VDC or 120 VAC or 240 VAC	2 Slots	20 mA	188 mA
4100-3209	Eight single-pole, double-throw (SPDT) switches	3 A 30 VDC or 120 VAC	1.5 A 30 VDC or 120 VAC	1 Block	16 mA	200 mA

**Table 27: Miscellaneous accessories**

Model	Description
4100-1279	Single blank 2 in. display cover, 4100-2302 provides a single plate for a full bay
4100-9856 See note	4100ES Canadian French Appliqu� Kit, Simplex, 4100ES, Contr�le Incendie
4100-9857 See note	4100ES English Appliqu� Kit, Simplex, 4100ES, Fire Control
4100-9858 See note	4100ES InfoAlarm Remote Display English Appliqu� Kit, Simplex, Operator Interface, 4100ES
4100-9869	Special Purpose Appliqu� Kit, Simplex, Sprinkler Waterflow and Supervisory Station, 4100ES
4100-9835	Termination and Address Label Kit (for module marking), provides additional labels for field installed modules
4100-6034	Tamper Switch, one for each cabinet assembly if required. Monitors solid door for panels with solid door. Monitors the internal retainer panel for panels with glass door (not the glass door), has a built-in addressable IDNet IAM.
2081-9031	Series resistor for WSO, IDCs (N.O. water flow and tamper on same circuit, wires after water flow and before tamper) 470 �, 1 W, encapsulated, two 18 AWG leads (0.82 mm <sup>2</sup> ), 2 1/2 in. L x 1 3/8 in. W x 1 in. H (64 mm x 35 mm x 25 mm)

**Note:** 4100ES English Appliqu s are included with 4100ES Upgrade and Retrofit Kits for mounting 4100ES in 4100, 2120, 2001, and Simplex back boxes so that upgrades can be easily identified as 4100ES. 4100ES Appliqu  Kits are available for applications such as:

- to update Remote InfoAlarm Displays connected to a panel that was upgraded to 4100ES
- for an existing 4100U when the New Master Controller is upgraded to 4100ES and only a software upgrade is required

When required, French appliqu s are ordered separately.

## Network Interface and Network Media Card Product Selection

4100ES fire alarm control units are compatible with Simplex ES Net network or 4120 network fire alarm products.

- Refer to datasheet *S4100-0076* for additional information on compatible ES Net fire alarm products.
- Refer to datasheet *S4100-0056* for additional information on compatible 4120 fire alarm products.

## Additional 4100ES and network product reference

**Table 28: Additional 4100ES and network product reference**

Subject	Data Sheet
Serial DACT (SDACT) for 4100ES, 4010ES, 4007ES	S2080-0009
Connected Services Gateway - Central Station Communication and SafeLINC Cloud Services	S2080-0091

**Table 28: Additional 4100ES and network product reference**

<b>Subject</b>	<b>Data Sheet</b>
Battery and Battery Cabinet Reference for 4100ES	S2081-0006
110 Ah Batteries and Cabinets for 4100ES	S2081-0012
4009 IDNet NAC Extender	S4009-0002
4009 IDNAC Repeater	S4009-0004
External 110 Ah Battery Charger for 4100ES, 4010ES	S4081-0002
IDNet Isolator2	S4090-0017
IDNet Isolator2 Base	S4098-0026
Graphic I/O Modules for 4100ES, 4010ES, 4007ES	S4100-0005
Interface to VESDA Air Aspiration Detection Systems	S4100-0026
4100ES LED/Switch Modules and Printer	S4100-0032
Master Clock Interface	S4100-0033
4100ES Enclosures	S4100-0037
4100ES Extinguishing Release Applications	S4100-0040
TFX Interface Module	S4100-0042
2120 BMUX Module	S4100-0048
Multiple Signal Fiber Optic Modems for 4120 Networks	S4100-0049
BACpac Ethernet Module	S4100-0051
4120 Network Products and Specifications	S4100-0056
Building Network Interface Card (BNIC)	S4100-0061
SafeLINC Internet Interface	S4100-0062
Emergency Voice/Alarm Communications Equipment with ES-PS Power Supplies	S4100-1034
MINIPLEX Transponders with ES-PS Power Supplies	S4100-1035
NDU with ES-PS Power Supplies for 4120 Network	S4100-1036
4100ES Remote Annunciator Panels with ES-PS Power Supplies	S4100-1039
Remote ES Touch Screen Displays for 4100ES and 4010ES Panels	S4100-1070
ES Net Network Products and Specifications	S4100-0076
NDU with ES-PS Power Supplies for ES Net	S4100-1077
TrueSite Workstation	S4190-0016
TrueSite Incident Commander	S4190-0020
Network System Integrator (NSI) for ES Net and 4120 Networks	S4190-0026
24-Pin Dot Matrix Fire Alarm System Remote Printer	S4190-0027
SCU/RCU Announciators for 4007ES, 4010ES, 4100ES	S4602-0001
LCD Annunciator for 4100ES	S4603-0001

---

All specifications and other information shown were current as of document revision and are subject to change without notice. Additional listings may be applicable, contact your local Simplex® product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. Simplex, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. NFPA 72 and National Fire Alarm Code are registered trademarks of the National Fire Protection Association (NFPA).